

6		5		4		3		2		1	
FILE: 2106.03											
REV		E.C.N. NO.		CONTENT				CHK		DATE	

Technical data:

Product properties




1. Product type: Disconnect terminal block
2. Number of connections: 4
3. Number of rows: 1
4. Potentials: /

Electrical properties

1. Nominal voltage: /
2. Rated surge voltage: 8KV
3. Nominal current: 16A
4. Maximum load current: /
5. Nominal cross section: 4mm²
6. Overvoltage category: III
7. Degree of pollution: 3
8. Operating temperature range: /
9. Insulating material: PA
10. Flammability rating according to UL 94: V2

Connection data

1. Conductor cross section rigid: 0.2mm²–6mm²
2. Cross section AWG: 24–10
3. Conductor cross section flexible: 0.2mm²–4mm²
4. Conductor cross section, flexible AWG: 24–12
5. Stripping length: 8mm

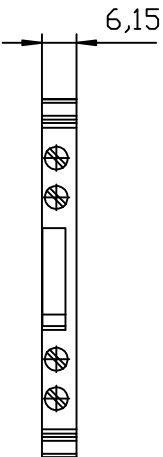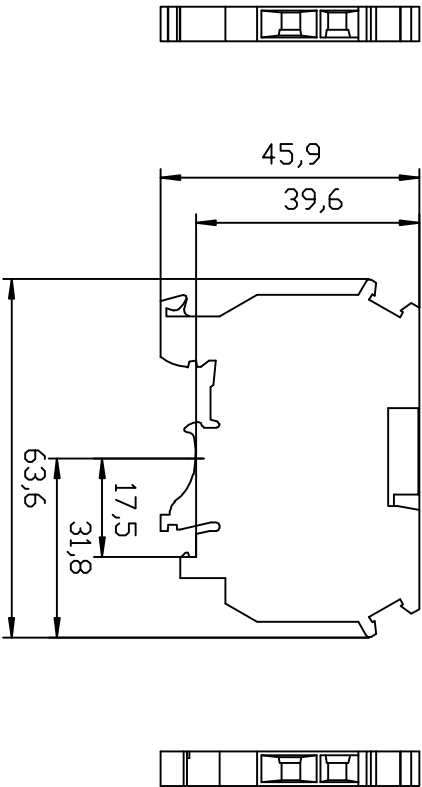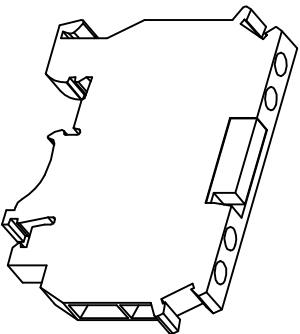

2		UL0-TB140-UDK4-MTK BU		Blue	
1		UL0-TB140-UDK4-MTK		Gray	
ITEM	NAME OF PART		Color		
A					
Total Pitch Tolerances			Nominal dimension range		
in mm			in mm		
over	over	over	over	over	over
0	30	53	70	90	115
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150	200
to	to	to	to	to	to
30	53	70	90	115	150
to	to	to	to	to	to
53	70	90	115	150</	